


 Cite this: *RSC Adv.*, 2017, 7, 22433

The impact of zeta potential changes on *Ceratium hirundinella* cell removal and the ability of cells to restore its natural surface charge during drinking water purification

 H. Ewerts,^{id} S. Barnard^{*a} and A. Swanepoel^b

Unit processes of a conventional water purification facility are designed to remove suspended material from source water (both inorganic and organic impurities). Organic substances in source water include phytoplankton species (algae and cyanobacteria) that are generally negatively charged on the surface of the cells. The zeta potential (ZP) of algal cells needs to be destabilized in order to enhance removal thereof during water purification. The aims of this study were to investigate the ZP changes of *Ceratium hirundinella* (*C. hirundinella*) cells and the ability of cells to restore their natural ZP during the water purification process. *C. hirundinella* cells (>500 cells per mL) were collected from the Middle Lake in South Africa (coordinates: 26°10'50.40"S; 28°17'50.11"E). A six paddle jar test apparatus was used to simulate unit processes under laboratory conditions using 3 different coagulant options. The ZP analyser with a built-in calibrated pH meter was used to analyse the ZP and pH of the cells and the filtered source water. The coagulant concentration of 10 mg L⁻¹ Ca(OH)₂ and 10 mg L⁻¹ organic polymer achieved the best coagulation conditions as assessed against an operation ZP window of between -10 mV to +3 mV. This Ca(OH)₂ and organic polymer dosing concentration was used to purify water with increasing cell concentrations (2000 cells per mL to 7000 cells per mL, increments of 1000) applying settling times of 20 minutes, 120 minutes and 240 minutes. Results obtained indicated high percentages of cell removal after 20 minutes (82–88%), 120 minutes (93%) and 240 minutes (95%) respectively. However, after extended settling times (120–240 minutes), more metabolically active cells were observed in the supernatant of samples containing higher cell concentrations. The findings showed that the ZP of *C. hirundinella* cells changes as a result of adding coagulants to form flocs, but may be restored when water purification facilities employ poor optimization practices and allow extended settling periods or retention times.

 Received 26th January 2017
Accepted 9th March 2017

DOI: 10.1039/c7ra01185g

rsc.li/rsc-advances

1. Introduction

A wide variety of particulate impurities which include inorganic substances such as clays and metal oxides, various organic colloids and microbes (viruses, bacteria, protozoa and phytoplankton) occur in natural waters.⁴ These suspended particles in solutions such as algal cells in surface water often have a charge on the surface (mostly negatively charged) and the magnitude thereof can be determined electrophoretically.³ The conversion of particles in a solution from a stable state to an unstable state (destabilization) can be accomplished in the conventional water treatment processes of coagulation and flocculation³ during which these impurities aggregate to form

flocs. Coagulation and flocculation is the result of the particle collisions and charge interactions between coagulants and surfaces of impurities found in water.⁹ Aggregation of particles in an aqueous solution is influenced by various factors such as surface charge, ZP, aggregation kinetics and the distributions of ions. The ZP is the electrical potential difference at the hydrodynamic slip plane, the interface between the aqueous fluid and the stationary layer of fluid attached to the bacterial or algal cell.²⁶

According to Manciu *et al.*,²³ the dispersion of ions in aqueous solutions is still a controversial topic, irrespective of the relevance thereof in biological and environmental processes. A study conducted by Alroudhani *et al.*¹ found that two cations (Ca and Mg) changed the ZP (decreasing the negative magnitude of ZP) of intact lime-stone solutions as a result of increasing concentrations. It is evident from previous studies^{1,10,23} that natural ZP in aqueous solutions are influenced by the addition of ions (anion and cations), which can support aggregation of particles

^aUnit for Environmental Sciences and Management, North-West University, Private Bag X6001, Potchefstroom, 2520, South Africa. Tel: +27 182992508. E-mail: sandra.barnard@nwu.ac.za

^bRand Water Analytical Services, PO Box 3526, Vereeniging, 1930, South Africa



suspended in water accomplished by destabilization. When coagulants are added to source water during treatment, positively charged coagulants react with suspended particles (colloidal and dissolved NOM) to aggregate and form flocs that are removed during separation processes such as sedimentation.⁵ The removal of these substances from the source water requires a specific coagulant demand, which affect the required coagulant dose.⁵ For smaller particles, separation efficiency can be greatly enhanced by aggregation; because of their surface charge these aquatic particles are often colloiddally stable and resistant to aggregation.⁴

When the magnitude of negative ZP is reduced, the surface charge of the suspended particles such as phytoplankton cells approaches 0 mV (charge neutralization and destabilization), which generally improves coagulation.^{14,33} Therefore the removal of algae during coagulation and flocculation requires that treatment processes are capable of neutralizing algal surface charges to ensure that they are effectively incorporated into flocs.¹⁸ ZP can be used to monitor and control coagulation of phytoplankton cells as confirmed by previous studies^{9,13,19,27,30} when using coagulants such as aluminum sulfate, hydrated lime ($\text{Ca}(\text{OH})_2$), sodium hydroxide, potassium and ammonium hydroxide to induce coagulation conditions. Gerde *et al.*⁹ also investigated the ZP control of the algae *Scenedesmus* spp., *Chlamydomonas reinhardtii* and *Schizochytrium limacinum* when dosing various cationic coagulants and stated that further research is required to investigate in greater detail how coagulants (or flocculants) change solution pH and surface ZP of algal cells to obtain more insights on the flocculation mechanisms involved. Zou *et al.*³⁴ investigated the mechanism of chitosan (a biopolymer) modified soil to remove phytoplankton (algae and cyanobacteria) cells from water and found that the long chain biopolymer with positively charged groups (NH_3^+) captured negatively charged algal cells effectively, while the soils provided the ballast to ensure floc removal during sedimentation.

The cells of dinoflagellate species are described in literature to easily avoid removal during conventional water treatment and penetrate into the final drinking water.^{7,31} Furthermore little is known about the relationship between ZP of these algal species such as, *C. hirundinella* and optimization of coagulation conditions. In previous studies, cyanobacterial and green algal species were mostly used during ZP investigations to determine the effectiveness of coagulants and coagulant aids.^{17,33} Unlike cyanobacteria cells that are covered with membranes and in some cases mucilage sheaths, the relatively large sized *C. hirundinella* cells are covered with unique cell coverings (theca plates) with different surface charge characteristics.

A chlorophyll breakthrough event into the treated water due to large numbers of *C. hirundinella* cells entering the final treated water, was observed at South Africa's largest conventional water treatment plant (SALCWTP) during the summer of 2006.³¹ This investigation focuses specifically on the use of $\text{Ca}(\text{OH})_2$ and a cationic organic polymer that will be dosed simultaneously and separately as part of the treatment options (as a primary coagulant or coagulant aid) to investigate the

influence of ZP on the coagulation conditions of the freshwater dinoflagellate, *C. hirundinella*.

The specific objectives of this study were to (1) investigate the change in ZP of *C. hirundinella* cells during coagulation when using various coagulants to simulate conventional coagulation, flocculation and sedimentation as well as to (2) evaluate whether cells were sufficiently neutralized to remain in aggregation (flocs), or whether cells were able to restore their natural surface charge after sedimentation and swim out of the flocs.

2. Materials and methods

2.1 Source water and sample collection

Source water samples (approximately 100 L) containing high concentrations *C. hirundinella* cells were collected from the Middle Lake in Benoni, Gauteng Province, South Africa (coordinates: 26°10'50.40"S; 28°17'50.11E). Two litre samples were prepared separately for jar tests using the following approach: (1) from the first one litre of sample most algae and bacteria were removed by filtration using 0.45 μm filters, (2) from the second one litre sample *C. hirundinella* cells were recovered using a 50 μm sieve and then finally (3) the *C. hirundinella* cells recovered with the 50 μm sieve were re-suspended in the 0.45 μm filtered water prepared in the first step. This resulted in a source water matrix enriched with *C. hirundinella* cells. Water samples (containing living *C. hirundinella* cells) were stored under laboratory conditions at $\pm 22^\circ\text{C}$. Six different *C. hirundinella* cell concentrations were prepared from a stock sample (containing 7000 cells per mL) to obtain a dilution range from 2000 cells per mL to 7000 cells per mL (with increments of 1000).

2.2 Coagulants

The following coagulants options were dosed within different concentration ranges: (1) hydrated lime in combination with activated silica ($\text{Ca}(\text{OH})_2\text{-SiO}_2$) in the range of 60 mg L^{-1} to 160 mg L^{-1} $\text{Ca}(\text{OH})_2$ and constant SiO_2 concentration (4 mg L^{-1}); (2) $\text{Ca}(\text{OH})_2$ in combination with organic polymer: with the organic polymer in the range of 4 mg L^{-1} to 14 mg L^{-1} and a constant $\text{Ca}(\text{OH})_2$ concentration (10 mg L^{-1}) and (3) organic polymer in a range of 4 mg L^{-1} to 14 mg L^{-1} .

2.3 Jar stirring tests and sampling for analytical determinations

The conventional water treatment processes coagulation, flocculation and sedimentation were simulated with a jar stirring apparatus (Phipps and Bird, Model 7790-704). Jar stirring experiments were conducted at room temperature ($\pm 22^\circ\text{C}$); using six 2 litre beakers filled with *C. hirundinella* enriched filtered source water. Known concentrations of different coagulants were added with syringes. The 2 litre (2 L) jar beakers with filtered source water containing pre-determined *C. hirundinella* cell concentrations were subjected to high energy jar stirring test conditions. Different coagulant concentrations were added with syringes and allowed to disperse uniformly at high energy flash mixing conditions. High energy flash mixing



conditions of 300 rpm (G -value of 400 s^{-1}) for 30 seconds, followed by the following decreasing G -values: 125 s^{-1} , 54 s^{-1} and 14 s^{-1} were applied. Stirring paddles were switched off to allow flocs to settle for 20 minutes. After conducting jar stirring tests the following samples were collected to perform specific analyses:

- Samples were collected from the supernatant after treatment with different coagulants to perform pH and *C. hirundinella* cell count analyses.
- Supernatant samples containing flocs were collected to perform ZP analyses after water treatment with various coagulants after 20 minutes and again after 120 minutes and 240 minutes.

2.4 ZP and pH

The ZetaPlus ZP analyser, manufactured by Brookhaven Instruments Corporation (model: BI-ZR3) (range of $\pm 150\text{ mV}$) was used to perform ZP measurements (laser specifications: 35 mW solid state laser, red, 660 nm wavelength; optional: 50 mW green, 532 nm). Approximately 1.6 mL of sample was transferred into square cuvettes and the electrodes of the ZetaPlus analyser were submerged into the sample. The surface charge of *C. hirundinella* cells was measured using the ZP Analyser software. Each ZP value is the average of 10 readings. The pH meter built into the ZetaPlus Analyser (calibrated pH probe) was used to determine the pH of samples simultaneously with ZP.

2.5 *Ceratium hirundinella* cell identification and enumeration

Source water and treated water (1000 mL) samples were collected and filtered through $0.45\text{ }\mu\text{m}$ filter paper to trap *C. hirundinella* cells. Cells trapped on filter paper were recovered and re-suspended in 10 mL using a vortex mixer. Samples were preserved with Lugol's solution (1 mL per 100 mL of sample) or 32% formaldehyde (2 mL per 100 mL of sample). The sedimentation/centrifugation technique, originally described by Lund *et al.*²¹ and adapted for Rand Water according to Swanepoel *et al.*³¹ was used for identification and enumeration. The concentration (cells per mL) and physical integrity of *C. hirundinella* cells were determined and evaluated using an inverted light microscope. All experiments were conducted in triplicate and the results were presented as the mean values.

2.6 Statistical analyses

Normality tests were performed in XLSTAT version 2014.1.07 for pH and ZP data. The following normality tests indicated a normal distribution for all data: Shapiro-Wilks, Anderson-Darling, Lilliefors and Jarque-Bera. A single factor analysis of variance (ANOVA) was performed to determine if there was a statistically significant difference between the average values of ZP and pH measurement determined in the source water (control) and after different coagulant treatments or after different settling times. ANOVA was performed using GraphPad Prism for Windows version 4.00. The level of significance for all statistical analyses was set at 0.05 (p -value) and the hypotheses

were stated separately for each analysis with the hypothesised difference equal to zero.

3. Results

3.1 ZP, pH measurements and *C. hirundinella* cell concentration before (in source water) and after (after sedimentation) different coagulant treatments

Table 1 displays the ZP and pH values of *C. hirundinella* cells in filtered source water collected from Middle Lake in Benoni. The concentrations of *C. hirundinella* cells re-suspended in filtered source water varied between 392 and 616 cells per mL with an average ZP and pH values of -13.38 mV and 8.79 mV respectively during five different sampling occasions.

Table 1 The ZP of *C. hirundinella* cells, pH and cell concentrations recorded during five sampling occasions (Sampling 11 January–8 February 2012) collected from the Middle Lake source water ($n = 5$; \pm standard deviation)

| Sampling occasions | ZP (mV) | pH | <i>C. hirundinella</i> (cells per mL) |
|--------------------|----------|------|---------------------------------------|
| 1 | -12.43 | 8.63 | 392 |
| 2 | -9.67 | 8.95 | 594 |
| 3 | -14.90 | 8.82 | 538 |
| 4 | -14.83 | 8.75 | 515 |
| 5 | -15.05 | 8.81 | 616 |
| Average values | -13.38 | 8.79 | 531 |
| Standard deviation | 2.34 | 0.12 | 87.78 |

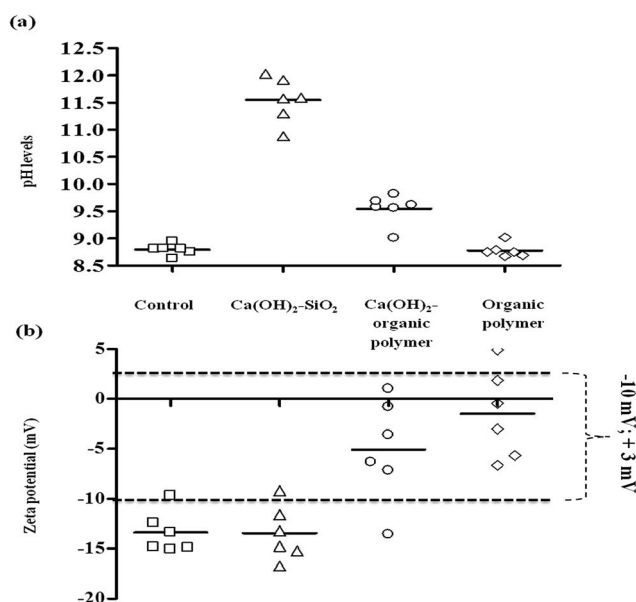


Fig. 1 Screening test results of pH and ZP for the selection of an appropriate coagulant chemical option range. Dotted lines indicate the ZP range required for good coagulation. $\text{Ca}(\text{OH})_2$ concentrations ranged from 60 mg L^{-1} to 160 mg L^{-1} (equal increment of 20), SiO_2 concentrations were constant as 4 mg L^{-1} (coagulant aid). Concentrations of $\text{Ca}(\text{OH})_2$ in combination with organic polymer were 10 mg L^{-1} as a coagulant aid, while organic polymer concentrations were dosed in a range of 4 mg L^{-1} to 14 mg L^{-1} .



Fig. 1 displays the changes in pH values and ZP values after dosing different coagulant ranges for Ca(OH)_2 - SiO_2 , Ca(OH)_2 -organic polymer and organic polymer. The ZP range proposed by Sharp *et al.*²⁸ required for good coagulation (-10 mV to $+3$ mV) is indicated by the dotted line in Fig. 1b and will be used to evaluate the efficacy of coagulants to meet optimum coagulation conditions. The efficacy of coagulants to meet the required surface charge changes will be evaluated using the initial negative ZP values recorded in the table above for *C. hirundinella* cells against the values obtained after treatment with different coagulant options.

The magnitude of negative ZP values measured for the Ca(OH)_2 - SiO_2 treatment option were not reduced effectively to achieve appropriate coagulation ZP values within the range of -10 mV to $+3$ mV. In contrast to Ca(OH)_2 - SiO_2 , Ca(OH)_2 -organic polymer and organic polymer were able to reduce the magnitude of negative ZP on *C. hirundinella* cells in the filtered raw water suspension (Fig. 1b). The pH measurements showed a significant increase at the lowest Ca(OH)_2 concentration in combination with SiO_2 from pH 8.79 (control) to pH levels above 10.50, where-after an increasing pH trend was recorded as a result of increased coagulant concentrations (Fig. 1a). When dosing Ca(OH)_2 in combination with SiO_2 , the lowest Ca(OH)_2 concentration of 60 mg L^{-1} caused the initial ZP to decrease (Fig. 1b; from -13.38 mV to -16.71 mV). However, the subsequent increasing Ca(OH)_2 concentrations showed an increasing ZP trend, but it remained below the proposed ZP range required for good coagulation conditions.

Increased pH levels ($>\text{pH } 9.70$) were recorded for the lowest organic polymer concentration which can be ascribed to the low constant Ca(OH)_2 dosage of 10 mg L^{-1} . The organic polymer concentration of 4 mg L^{-1} in combination with Ca(OH)_2 (10 mg L^{-1}) kept the initial ZP of -13.38 mV relatively constant at a value of -13.57 mV, but an increase in ZP values were recorded when organic polymer concentrations were increased. ZP values for organic polymer flocculant (4 – 14 mg L^{-1}) in combination with Ca(OH)_2 (10 mg L^{-1}) were mostly within the proposed ZP range required for good coagulation conditions (Fig. 1b). The concentration of 10 mg L^{-1} for organic polymer was identified as the most optimal within the range of 4 mg L^{-1} to 14 mg L^{-1} , while for Ca(OH)_2 was kept constant at 10 mg L^{-1} as the coagulant aid for pH adjustments.

Organic polymer (4 – 14 mg L^{-1}) treatment without low Ca(OH)_2 concentration (10 mg L^{-1}) caused no pH adjustments, since pH levels remained similar to the control (Fig. 1a). The ZP value range was closer to 0 mV (-6.64 mV to $+4.90$ mV) than what was observed for Ca(OH)_2 -organic polymer range that was recorded between -13.57 mV and $+1.00$ mV as illustrated Fig. 1b. ANOVA results also indicate that after treating source water containing *C. hirundinella* cells with various coagulant

ranges, the average pH values ($p = <0.0001$) and ZP values ($p = <0.0001$) were significantly different compared to the control (Fig. 1a and b).

When dosing Ca(OH)_2 in combination with SiO_2 and Ca(OH)_2 in combination with organic polymer, the pH increased from 8.79 to 11.5 and 9.5 respectively, while organic polymer alone was not able to change the pH of the filtered source water (Fig. 1a). Although the pH levels were significantly increased by Ca(OH)_2 - SiO_2 treatment, the ZP values remained constant when compared to the ZP values (mostly ≤ -10 mV) recorded in the source water (Fig. 1b). On the other hand, both Ca(OH)_2 -organic polymer and organic polymer exhibited changes in the ZP values from ≤ -10 mV to ≥ -5 mV (Fig. 1b). It was clear from the results that Ca(OH)_2 - SiO_2 did not influence the ZP and organic polymer alone was not able to influence the pH, but Ca(OH)_2 -organic polymer was able to influence both ZP and pH to achieve more effective coagulation conditions.

3.2 Using a constant established coagulant dose to treat source water enriched with different *C. hirundinella* cell concentrations and with different settling times

Table 2 gives the initial ZP of *C. hirundinella* cells and pH values of filtered source water containing different *C. hirundinella* cell concentrations. The initial ZP values varied between -13 mV and -21 mV, while the pH values varied between pH 6.97 and pH 7.34.

The magnitude of ZP (average -13.38 mV) measured for *C. hirundinella* cells in natural source water (Table 1) was reduced to -21 mV for some of the concentrated *C. hirundinella* suspensions (Table 2). A decrease in pH values were observed from an average pH of 8.79 in the source water (Table 1) to pH values varying between pH 6.97 and pH 7.34 recorded for the six concentrated *C. hirundinella* suspensions (Table 2).

For the different cell concentrations (2000–7000 cells per mL) the organic polymer dose per cell varied from 5.5 ng per cell to 1.5 ng per cell. Therefore, less coagulant becomes available as a result of increasing cell concentrations. The percentage removal achieved after a settling time of 20 minutes (which is the appropriate settling time simulation of a treatment plant by means of a jar stirring test) varied from 82% to 88%. After 120 minutes and 240 minutes the percentage removal was improved to percentages up to 93% and 95% respectively (Fig. 2). An increasing trend for the number of cells not removed, was recorded after treatment of the supernatant possibly as a result of the increasing initial cell concentration and constant optimized coagulant concentrations. Extended settling times up to 120 minutes or 240 minutes improved the percentage removal to relatively similar percentage removals $>90\%$.

Table 2 The ZP and pH measurements of the six pre-determined initial *C. hirundinella* concentrations that were used in simulated jar stirring test experiments with Ca(OH)_2 -organic polymer (average values of 30 readings)

| <i>C. hirundinella</i> concentrations (cells per mL) | 2000 | 3000 | 4000 | 5000 | 6000 | 7000 |
|--|-------|-------|-------|-------|-------|-------|
| ZP (mV) | -21 | -21 | -17 | -13 | -17 | -19 |
| pH | 6.97 | 7.14 | 7.18 | 7.26 | 7.31 | 7.34 |



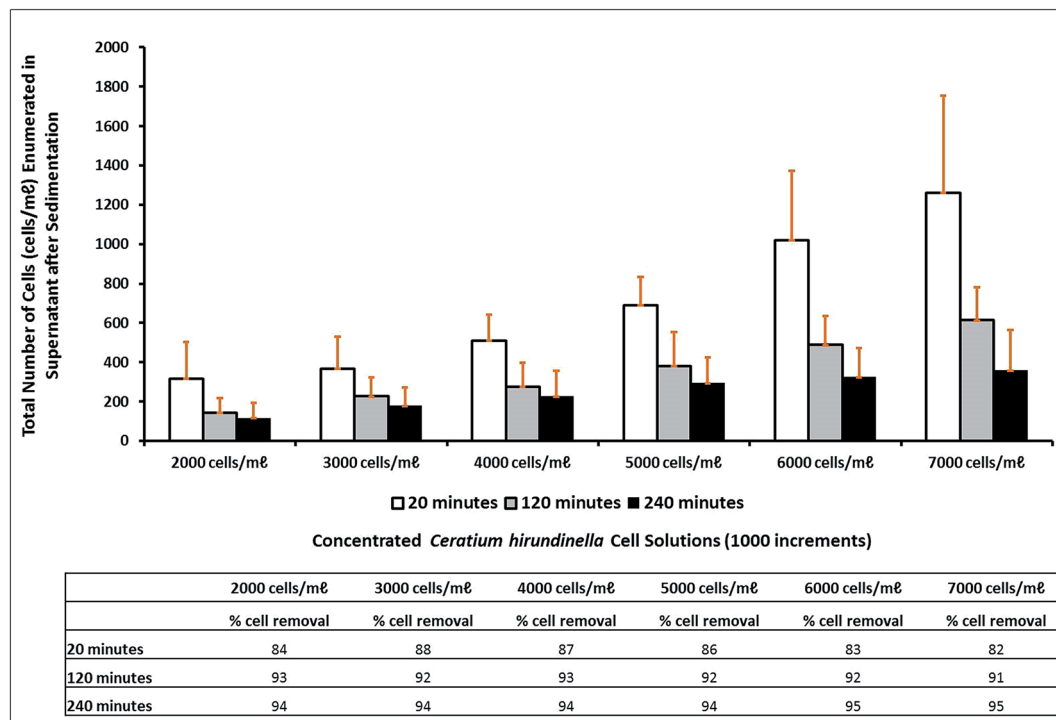


Fig. 2 The percentage of *C. hirundinella* cells removed after settling times of 20 minutes (□), 120 minutes (▤) and 240 minutes (■) after dosing a combination of $\text{Ca}(\text{OH})_2 = 10 \text{ mg L}^{-1}$ and organic polymer = 11 mg L^{-1} .

The following ZP values were recorded in source water containing different initial *C. hirundinella* cell concentrations from 2000 cells per mL to 7000 cells per mL (increments of 1000): -21 mV , -21 mV , -17 mV , -13 mV , -17 mV and -19 mV respectively (Table 2). After a settling time of 20 minutes, the initial ZP values were reduced to the proposed range of -10 mV to $+3 \text{ mV}$ for good coagulation conditions. The best average ZP value (-3.28 mV) was recorded after treating source water with the highest initial *C. hirundinella* cell concentrations

(Fig. 3). After extended settling periods (up to 120 minutes and 240 minutes), the ZP values have shown a slight change towards restoration of surface charge, notably for suspensions containing higher initial *C. hirundinella* cell concentrations (6000–7000 cells per mL) (Fig. 3).

The pH changing factor for source water with increasing initial cell concentration was constant at a concentration of 10 mg L^{-1} for $\text{Ca}(\text{OH})_2$. The pH levels recorded after a settling time of 20 minutes varied between pH 9.64 and pH 9.75, which

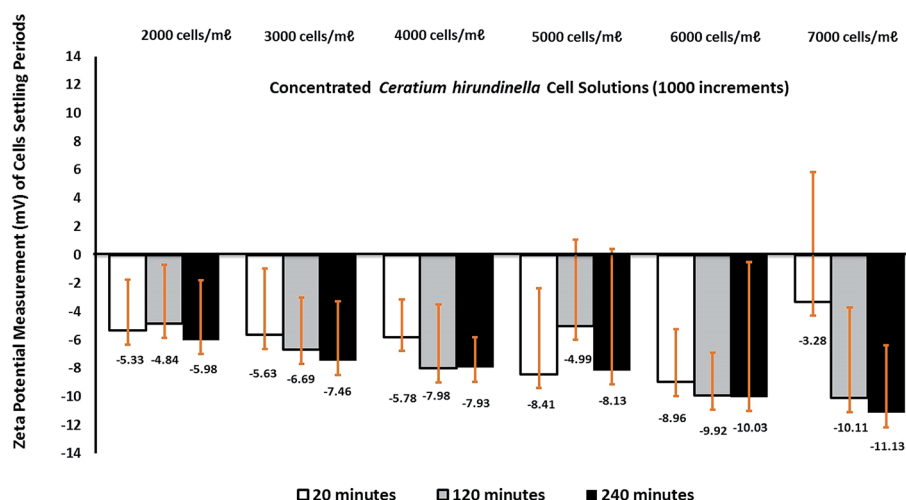


Fig. 3 The changes in ZP after different settling times (20 minutes (□), 120 minutes (▤) and 240 minutes (■)) when dosing the same coagulant concentrations ($\text{Ca}(\text{OH})_2 = 10 \text{ mg L}^{-1}$; organic polymer = 11 mg L^{-1}) to treat water with increasing *C. hirundinella* cell concentrations.

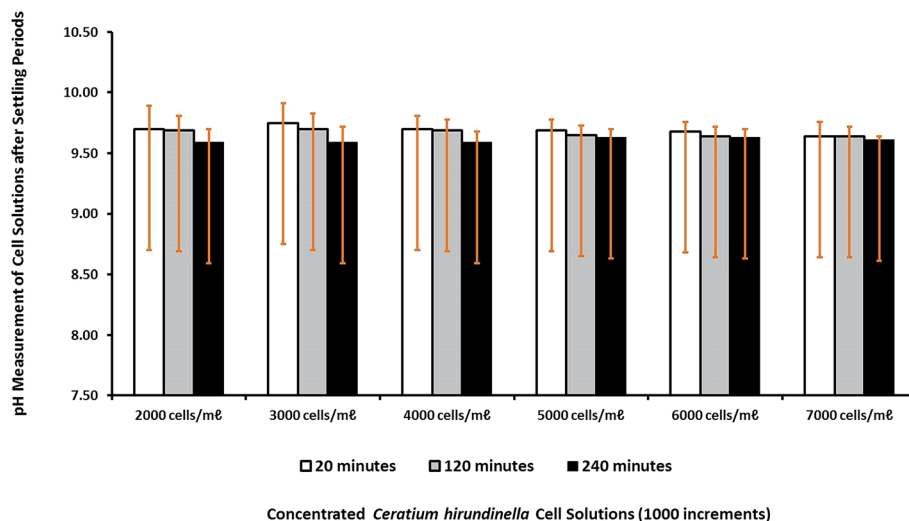


Fig. 4 The pH levels measured in the supernatant after different settling times (20 minutes (□), 120 minutes (▤) and 240 minutes (■)) when dosing the same coagulant concentrations ($\text{Ca(OH)}_2 = 10 \text{ mg L}^{-1}$; organic polymer = 11 mg L^{-1}) to treat water with increasing *C. hirundinella* cell concentrations.

were the highest pH levels. The pH changes measured after different settling times were relatively similar around pH 9.5–9.6 as expected for the a Ca(OH)_2 concentration of 10 mg L^{-1} (Fig. 4).

4. Discussion

Within conventional drinking water treatment plants the processes of coagulation and flocculation are considered to be principally responsible for removing negatively charged algae.¹² These processes are followed by sedimentation as particles cluster together and their settling rates increase.³² Ineffective coagulation conditions for algal removal can however be monitored and corrected by controlling the magnitude of ZP of the algal cells to subsequently avoid water treatment difficulties.

The source water (collected from Middle Lake) used during this investigation contained relatively high *C. hirundinella* cell concentrations (>500 cells per mL); therefore, coagulant optimization strategies should form part of the water treatment process. The laboratory-scale simulations of coagulation, flocculation and gravity sedimentation (conducted with a six paddle jar stirrer apparatus) used, were based on South Africa's largest conventional water treatment plant's (SALCWTP) treatment conditions, where the use of Ca(OH)_2 is a unique practice as primary coagulant or a coagulant aid.^{7,8} High Ca(OH)_2 concentrations (ranging between 60 and 160 mg L^{-1}) have proved to increase the pH of the source water significantly (>pH 11.5 after sedimentation), while a lower constant concentration of Ca(OH)_2 (10 mg L^{-1}) in combination with organic polymer increased the pH only moderately (>pH 9.5).

Algal cells such as *C. hirundinella* are expected to flocculate or form flocs in a ZP operating window of -10 mV to $+3 \text{ mV}$.²⁸ However according to Shen *et al.*²⁹ algae are generally expected to be negatively charged with a ZP larger than -40 mV , which is difficult to be decreased in order to form a stable floc. This

range as opposed to a single ZP value (0 mV) suggests that in general, colloidal destabilization occurs before complete charge neutralization of surface charge takes place.^{6,16,25} *C. hirundinella* cells with an average ZP measurement of -13.38 mV in natural source water was attained for this study, which should therefore have less difficulty to form stable flocs provided that the sufficient coagulant concentration is added. During this investigation no significant changes in ZP of the *C. hirundinella* cells occurred as a result of high Ca(OH)_2 concentration in combination with activated silicate (SiO_2). On the other hand, it was observed that the magnitude of negative ZP was reduced as a result of dosing Ca(OH)_2 in combination with organic polymer or when dosing organic polymer separately. A low Ca(OH)_2 concentration (10 mg L^{-1}) as coagulant aid in combination with 10 mg L^{-1} organic polymer showed the best results and this combination have impacted on both the pH (>9.5) and ZP (-6.64 mV to $+4.90 \text{ mV}$). The adjustment of pH by adding, among others, Ca(OH)_2 , NaOH and Na_2CO_3 promotes alkalinity which will affect not only the buffer capacity of the solution but also decrease the ZP values.²⁰ This finding provides evidence that use of positively charged organic polymer treatments are effective to destabilise and increase the negative ZP charges of cells in suspension sufficiently to promote coagulation. A similar investigation conducted by Jameson¹⁵ showed that as the organic polymer concentration increased, an increase in the ZP is observed until it eventually crosses the isoelectric point and becomes positively charged. This finding is confirmed in Fig. 1, where most of the ZP values are recorded within the ZP operating window (-10 mV to $+3 \text{ mV}$) close to the isoelectric point.

Henderson *et al.*¹¹ observed that algae may not start to form flocs until 7 minutes of slow mixing has passed, which was adequately provided for during this study as a lag time for charge neutralization. After a settling time of 20 minutes good removal of cells were observed (Fig. 2), which can be ascribed to



effective charge destabilisation reducing initial ZP values to the coagulation operating window (-10 mV to $+3$ mV) under good coagulation conditions (e.g. $>\text{pH } 9$). Improvements in removal efficiencies were observed (from a maximum of 88% to a maximum of 95%) as a result of extended settling periods (up to 120 minutes and 240 minutes). The retention times for floc settling in large gravity sedimentation tanks as observed at SALCWTP last maximally 240 minutes.

Bernhardt *et al.*² stated that when algae concentrations in source water fluctuate, the concentrations of negative charges in the source water and the coagulant dose required for the neutralization these charges can vary rapidly. During this study increasing negative magnitudes for ZP (up to -21 mV) were observed in most of the suspensions containing higher cell concentrations (≥ 2000 cells per mL) while pH values were slightly lower (ranging between pH 6.97 and pH 7.34). Surface charge restoration tendencies were observed after extended settling periods, even in suspensions with low initial cell concentrations (2000–3000 cells per mL). The restoration of ZP observed in higher initial cell concentrations (6000–7000 cells per mL) can possibly be due to the fact that with increasing cell concentrations less of the coagulant is available per cell. However, a study on the ZP of two cyanobacteria cells belonging to the genera *Planktothrix* sp. and *Synechococcus* sp. indicated that cells may also metabolically control cell surface charge to electrostatically attract bicarbonate anions at alkaline pH, required for photosynthesis.²² Algal cells can also regulate their surface charge by ion transport across the cell wall.¹⁸ Pieterse and Cloot²⁴ also stated that if algal cells are in equilibrium with themselves, it is possible that the negative surface charge of algal cells will be restored after charge neutralization. This apparent surface charge recovery can be ascribed to metabolic processes such as photosynthesis and respiration²⁴ rather than changes in pH. This statement is also supported by Martinez *et al.*²² who found that the ZP for dead, but non-acidified *Synechococcus* sp. remained negative (at -30 mV from an initial pH of 5.6 to 10.5), reflecting that metabolically active cells definitely have the ability to restore its natural surface charge.

5. Conclusions

Natural source water samples were used to evaluate efficacy of different coagulant options to achieve the best coagulation conditions, with emphasis on the ZP operating window (-10 mV to $+3$ mV) and to record the alkaline pH values associated with the effective ZP range required for floc formation. The ZP of the freshwater dinoflagellate *C. hirundinella* cells in natural source water varied between -9.67 mV and -15.05 mV at pH levels around 8.79, while ZP in prepared cell solutions with higher cell concentrations varied between -13 mV and -21 mV around neutral pH levels (pH 6.97–7.34).

The coagulant option consisting of a constant $\text{Ca}(\text{OH})_2$ concentration of 10 mg L^{-1} (added as a coagulant aid) in combination with an organic polymer range (4 mg L^{-1} to 14 mg L^{-1}) achieved the best coagulation conditions. The optimal concentrations for both the coagulant aid and organic polymer were 10 mg L^{-1} . This concentration was selected for $\text{Ca}(\text{OH})_2$

and organic polymer to evaluate the ability of *C. hirundinella* cells to restore its ZP after 20 minutes, 120 minutes and 240 minutes using increasing cell concentrations (2000 cells per L to 7000 cells per L with equal increments of 1000). It was observed that when these concentrations of coagulants are added to filtered source water solutions with increasing cell concentrations, more cells that are metabolically active will be present. This results in *C. hirundinella* cells floating or swimming in the supernatant or cells not forming part of flocs/aggregates that will be carried over to the next stage of water purification. In the event when high *C. hirundinella* cell concentrations enters a water purification facilities, effective monitoring and optimization strategies should be implemented to ensure coagulant concentrations are added that will achieve ZP for and pH conditions to form stable flocs with less cells floating in the supernatant. ZP changes of *C. hirundinella* cells occur as a result adding coagulants to form flocs, but may be restored when water purification facilities employ poor optimization practices and allow extended settling periods or retention times.

Acknowledgements

The authors express their sincere gratitude to Analytical Services, Scientific Services of Rand Water in South Africa for their financial support and providing their facilities to conduct the research. In addition, Prof. H. H. Du Preez (Rand Water, South Africa) and Dr S. Janse van Vuuren (North-West University, South Africa) for their support and scientific inputs.

References

- 1 A. Alroufhan, J. Vinogradov and M. D. Jackson, *Colloids Surf., A*, 2016, **493**, 83–98.
- 2 H. Bernhardt, B. Lüsse and O. Hoyer, *Journal of Water-Wastewater Research*, 1986, **19**, 219–228.
- 3 BIC (Brookhaven Instruments Corporation), Holtsville, New York 11742, 2002.
- 4 J. Duan and J. Gregory, *Advances in Colloidal and Interface Science*, 2003, **100–102**, 475–502.
- 5 J. K. Edzwald, D. J. Pernitsky and W. L. Parmenter, Article in Chemical Water and Wastewater Treatment VI, *Polyaluminum Coagulants for Drinking Water Treatment: Chemistry and Selection*, ed. H. H. Hahn, E. Hoffmann and H. Ødegard, Springer, Berlin, Heidelberg, New York, 2000.
- 6 B. Eikkebrokk, T. Juhna and S. W. Østerus, *TECHNEAU D*, 2006, **5.3.1a**, 1–107.
- 7 H. Ewerts, S. Barnard, A. Swanepoel, H. H. Du Preez and S. Janse van Vuuren, *Water Sci. Technol.: Water Supply*, 2014, **14**(5), 820–828.
- 8 H. Ewerts, A. Swanepoel, H. H. Du Preez and N. van Der Walt, *J. Water Supply: Res. Technol.-AQUA*, 2015, **64**(1), 1–8.
- 9 J. A. Gerde, L. Yao, J. Y. Lio, Z. Wen and T. Wang, *Algal Res.*, 2014, **3**, 30–35.
- 10 H. He, Y. Cheng, C. Yang, G. Zeng, C. Zhu and Z. Yan, *J. Environ. Sci.*, 2016, DOI: 10.1016/j.jes.2016.06.009.
- 11 R. K. Henderson, E. Sharp, P. Jarvis, S. Parsons and B. Jefferson, *Water Sci. Technol.: Water Supply*, 2006, **6**, 31–38.



- 12 R. K. Henderson, S. A. Parsons and B. Jefferson, *Water Res.*, 2008a, **42**(8–9), 1827–1845.
- 13 R. K. Henderson, S. A. Parsons and B. Jefferson, *Sep. Sci. Technol.*, 2008b, **43**(7), 1653–1666.
- 14 M. Hjorth and B. U. Jorgensen, *Water Res.*, 2012, **46**(4), 1045–1051.
- 15 G. J. Jameson, *Colloids Surf., A*, 1999, **151**, 269–281.
- 16 B. Jefferson, E. L. Sharp, E. Goslan, R. K. Henderson and S. A. Parsons, *Water Sci. Technol.: Water Supply*, 2004, **4**(5–6), 49–56.
- 17 H. Jun, Y. Lee, B. Lee and D. R. U. Knappe, *J. Water Supply: Res. Technol.-AQUA*, 2001, **50**(3), 135–148.
- 18 D. R. U. Knappe, R. C. Belk, D. S. Briley, S. R. Grandy, N. Rastogi and A. H. Rike, *AWWA Research Foundation*, 2004, 1–466.
- 19 L. Li, H. Zhang and G. Pan, *J. Environ. Sci.*, 2015, **28**, 47–53.
- 20 H. Lohtaja, *Bio-ja elintarviketekniikka, Laboratory Technology*, Turku University of Applied Sciences, City of Turka, Finland, 2005.
- 21 J. W. G. Lund, C. Kipling and E. D. LeCren, *Hydrobiologia*, 1958, **11**, 143–170.
- 22 R. E. Martinez, O. S. Pokrovsky, J. Schott and E. H. Oelkers, *J. Colloid Interface Sci.*, 2008, **323**, 317–325.
- 23 M. Manciu, F. S. Manciu and E. Ruckenstein, *Advances in Colloid and Interface Science*, 2016, DOI: 10.1016/j.cis.2016.06.006.
- 24 A. J. H. Pieterse and A. Cloot, *Water Sci. Technol.*, 1997, **36**(4), 111–118.
- 25 H. Ratnaweera, N. Hiller and U. Bunse, *Environ. Int.*, 1999, **25**(2–3), 347–355.
- 26 T. Saito, T. Takatsuka, T. Kato, K. Ishihara and K. Okuda, *Arch. Oral Biol.*, 2001, **42**, 539–545.
- 27 A. Schlesinger, D. Eisenstadt, A. Bar-Gil, H. Carmely, S. Einbinder and J. Gressel, *Biotechnol. Adv.*, 2012, **30**(5), 1023–1030.
- 28 E. L. Sharp, J. Banks, J. A. Billica, K. R. Gertig, R. K. Henderson, S. A. Parsons, D. Wilson and B. Jefferson, *Water Sci. Technol.: Water Supply*, 2005, **5**, 49–56.
- 29 Q. Shen, J. Zhu, L. Cheng, J. Zhang, Z. Zhang and X. Xu, *Desalination*, 2011, **271**, 236–240.
- 30 B. T. Smith and R. H. Davis, *Algal Res.*, 2012, **1**, 32–39.
- 31 A. Swanepoel, H. H. Du Preez, I. Dusrath and M. Rajele, *Water Institute of Southern Africa (WISA 2008)*, Sun City, South Africa, 2008.
- 32 P. J. L. B. Williams and L. M. L. Laurens, *Energy Environ. Sci.*, 2010, **3**, 554.
- 33 T. Yang, D. Kwak, S. Kim, J. Lee and H. Jung, *Water Sci. Technology: Water Supply*, 2005, **4**(28–4.30), 309–316.
- 34 H. Zou, G. Pan, H. Chen and X. Z. Yuan, *Environ. Pollut.*, 2006, **141**(2), 201–205.

