


 Cite this: *RSC Adv.*, 2020, 10, 19240

Analysis of rapid culture of high-efficiency nitrifying bacteria and immobilized filler application for the treatment of municipal wastewater†

 Shaolun Wang,^a Hong Yang,^{ID}*^a Fan Zhang,^b Yakun Zhou,^a Jiawei Wang,^a Zongyue Liu^a and Yang Su^{ID}^a

Activated sludge from the A²/O process in a wastewater treatment plant (WWTP) was used as the seed sludge for enrichment to achieve faster growth of nitrifying bacteria and higher nitrification efficiency of the filler made by nitrifying bacteria. The bacterial community was enriched in a self-circulating bacteria culture tank by a continuous ammonia feeding mode. The study found that the nitrifying bacteria community was enriched in 38 days with the ammonia oxidation rate of approximately 275.58 mg (L h)⁻¹. High-throughput sequencing demonstrated that *Nitrosomonas* belonging to ammonia-oxidizing bacteria (AOB) was predominant in the sludge after 38 days at a ratio extending from 0.43% to 61.91%. The enriched sludge was used as the bacterial source and the immobilization was carried out with polyvinyl alcohol (PVA). After the recovery culture, the ammonia oxidation rate of the filler was up to 44.61 mg (L h)⁻¹ for the treatment of municipal wastewater, and the effluent ammonia was below 1 mg L⁻¹, indicating that the immobilized filler is effective for municipal wastewater nitrification. Scanning electron microscope (SEM) observations showed that immobilized fillers were highly porous and bacteria adhered to the network structure, demonstrating that the filler provided a good growth microenvironment for microorganisms.

 Received 17th February 2020
 Accepted 29th March 2020

DOI: 10.1039/d0ra01498b

rsc.li/rsc-advances

1. Introduction

Traditional nitrification is a two-step process performed by ammonia-oxidizing bacteria (AOB) and nitrite-oxidizing bacteria (NOB) with long generation time, slow growth rate, high sensitivity for change of environment and susceptibility to loss in the reactor.^{1,2} The existing activated sludge method is a single sludge system, and various functional bacteria are in the sludge system, which cannot sufficiently perform nitrification. For the treatment of a relatively complicated wastewater such as industrial wastewater, the nitrification is still a limiting step in the biological nitrogen removal process.³

Studies have shown that the concentration of nitrifying bacteria in sewage is proportional to the rate of nitrification.⁴ A high cell concentration can be retained within the treatment system *via* immobilization, thus improving the reaction speed and reducing or eliminating the occurrence of side reactions.⁵⁻⁷

At present, immobilization technologies have been successfully applied to nitrifying bacteria.^{5,8,9} Most of its bacteria sources are activated sludge or sludge with low nitrification efficiency, which makes the concentration of nitrifying bacteria low in the immobilized filler and the efficiency of filler poor, and it is difficult to solve the tricky nitrification problem. Therefore, it is necessary to perform activated sludge screening and enrichment culture to improve the bacterial concentration and nitrification efficiency. Moreover, the enriched nitrifying bacteria can also be used in bioaugmentation or aquaculture to improve the nitrification function of biological treatment systems.¹⁰⁻¹² At present, nitrifying bacteria can be enriched with a relatively high initial ammonia concentration (*e.g.* about 500 mg L⁻¹) for a relatively long cultivation period (*e.g.* over 90 days).¹³ Few reports were available regarding rapid enrichment of nitrifying bacteria with high nitrification efficiency.¹⁴

Therefore, the objectives of this study were to: (1) explore a method for enriching the nitrifying bacteria community quickly that have high nitrification efficiency to guide the rapid culture of nitrifying bacteria, (2) design nitrifying immobilized fillers and investigate their nitrification performances for treatment of the simulated wastewater and municipal wastewater and (3) provide theoretical basis and technical support for solving the problem of nitrification.

^aKey Laboratory of Beijing for Water Quality Science and Water Environment Recovery Engineering, Beijing University of Technology, Beijing 100124, China. E-mail: yhong@bjut.edu.com

^bChina Wuzhou Engineering Group Corporation Ltd., China

† Electronic supplementary information (ESI) available. See DOI: 10.1039/d0ra01498b



2. Materials and methods

2.1. Continuous-flow operation

2.1.1. Seed sludge and synthetic feed. Nitrifying sludge was obtained from the return sludge in the Gao Bei Dian WWTP in Beijing, China. Details of the synthetic feed stock solution are shown in Table 1.

2.1.2. Experimental reactor set-up. A self-circulating bacteria culture tank (BMET Corp., China) with a working volume of 108 L was employed to enrich nitrifying bacteria (Fig. 1) and had three regions from outside to inside, namely sedimentation zone, diversion zone and agitation zone. The diversion and the agitation zones including the lower semi-spherical sphere are collectively referred to as the reaction zone. The reactor was fed with NH_4Cl (nitrogen source), KH_2PO_4 (phosphorus source), and Na_2CO_3 (pH buffer, alkalinity source) as well as a mineral stock solution detailed in Table 1. The temperature and pH were maintained at 24 ± 1 °C and 7.40–7.80, respectively, while the dissolved oxygen (DO) concentration was monitored through a DO probe (INESA Corp., China) and maintained at $1.00\text{--}1.50$ mg L^{-1} using an air flow meter (SENLOD Corp., China) during enrichment culture. The actual pH was adjusted according to the concentration of ammonia nitrogen and nitrite nitrogen in the reactor to control free ammonia (FA) and free nitrous acid (FNA) concentration that can inhibit nitrifying bacteria, and minimize the impact on the system. The samples were collected through a sampling port on the top of the reactor and the medicine inlet on the bottom of the reactor was used for feed addition. Drainage was carried out above the sedimentation zone.

2.1.3. Experimental procedure. During pre-aeration, the seed sludge was screened through endogenous respiration through continuous aeration without nutrient supply. During endogenous respiration, bacteria used their cell contents for metabolism, resulting in the death of a large number of heterotrophic bacteria, which could greatly reduce the interference to the rapid growth of nitrifying bacteria in the next stage.^{15–17}

Then, enrichment culture was carried out using the sludge by pre-aeration as a bacterial source. With the increase of the ammonia oxidation rate, the initial concentration was increased when the effluent $\text{NH}_4^+\text{-N}$ concentration was close to 10 mg L^{-1} . Hydraulic retention time (HRT) was maintained at 4 hours by adjusting the influent flow rate.

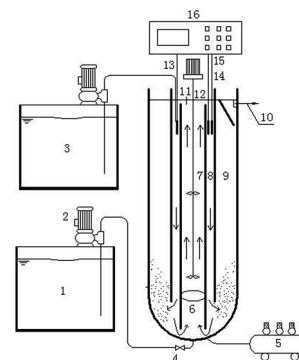


Fig. 1 Schematic diagram of experimental setup: (1) NH_4Cl feeding container, (2) feeding pump, (3) Na_2CO_3 feeding container, (4) valve, (5) air pump, (6) annular tube aerator, (7) agitation zone, (8) diversion zone, (9) sedimentation zone, (10) outlet, (11) sampling port, (12) stirrer, (13) pH probe, (14) temperature probe, (15) DO probe, and (16) operation interface.

2.2. Immobilized fillers

2.2.1. Preparation of immobilized nitrifying bacteria. After the enrichment of nitrifying bacteria, 65 L mixed liquid was centrifuged to prepare immobilized fillers. Other materials included calcium carbonate (CaCO_3 , 150–200 mesh); powdered activated carbon (100–200 mesh); boric acid (H_3BO_4) and PVA (degree of polymerization 2200, degree of alcoholysis 20–99%).¹⁸ All the above materials were of analytical purity.

PVA powder was dissolved in 95 °C water and mixed to form a 15% (w/w) PVA solution. After cooling to 35 °C, the PVA solution was mixed with the sludge with 95% water content after concentration, where sludge concentration (dry weight) accounted for 4% of the total mixture. Meanwhile, CaCO_3 (38.30 g L^{-1}) and powdered activated carbon (18.32 g L^{-1}) were added.¹⁹ The encapsulating solution was evenly coated on the cylindrical polypropylene mesh tube (length 50 cm, diameter 1 cm) and then put into a saturated boric acid solution to complete the cross-linking. Finally, the barrel immobilized filler was cut into small cylinders with a growth degree of 2 cm, and was filled in a suspension ball with 100 mm diameter. The active volume of the reactor was 150 L, filling with 10% of immobilized filler. The experimental parameters such as pH, DO, and temperature were controlled online using a Programmable Logic Controller (PLC). Specific parameters can be seen in the experiment operation.

Table 1 Composition of the synthetic feed stock solution

Compound	Concentration (mg L^{-1})	Trace element stock	Concentration (g L^{-1})
NH_4Cl	191–4286	$\text{ZnSO}_4 \cdot 7\text{H}_2\text{O}$	0.50
KH_2PO_4	38–857	$\text{Na}_2\text{MoO}_4 \cdot \text{H}_2\text{O}$	0.12
Na_2CO_3	2000	$\text{CoCl}_2 \cdot 6\text{H}_2\text{O}$	0.20
$\text{MgSO}_4 \cdot 7\text{H}_2\text{O}$	3	$\text{MnCl}_2 \cdot 4\text{H}_2\text{O}$	0.50
CaCl_2	2	$\text{NiCl}_2 \cdot 6\text{H}_2\text{O}$	0.70
Trace element stock	1 mg L^{-1}	$\text{CuSO}_4 \cdot 5\text{H}_2\text{O}$	0.60
		$\text{FeCl}_3 \cdot 6\text{H}_2\text{O}$	0.80



2.2.2. Experiment operations to immobilized fillers.

Reactor was operated at 24 ± 1 °C. The immobilized filler tests were divided into the filler recovery experiment and the comparison experiment. In the recovery experiment, DO and pH were monitored using a DO probe (INESA Corp., China) and a pH probe (INESA Corp., China), and maintained at 4–5 mg L⁻¹ and 7.30–7.50, respectively. HRT was maintained at 1 h. With the increase of the ammonia oxidation rate, the initial concentration was increased when the effluent NH₄⁺-N concentration was close to 10 mg L⁻¹.

In the comparison experiment, the influent water was the simulated NH₄⁺-N wastewater in phase I and the municipal wastewater with fluctuating NH₄⁺-N concentration in phase II. The experiments were run for 33 days and the DO was

$$\text{NAR (\%)} = \frac{[\text{NO}_2^- - \text{N}]_{\text{eff}} - [\text{NO}_2^- - \text{N}]_{\text{inf}}}{([\text{NO}_2^- - \text{N}]_{\text{eff}} - [\text{NO}_2^- - \text{N}]_{\text{inf}}) + ([\text{NO}_3^- - \text{N}]_{\text{eff}} - [\text{NO}_3^- - \text{N}]_{\text{inf}})} \times 100\% \quad (7)$$

maintained at 4.5–5.0 mg L⁻¹. The pH and the temperature of the municipal wastewater were 7.18–7.43 and 21.70–23.90 °C, respectively.

2.3. Analytical methods

The influent and effluent samples were collected from the continuous-flow reactor daily and analyzed immediately for NH₄⁺-N, NO₂⁻-N, NO₃⁻-N, and MLSS according to the standard methods.²⁰ The COD was measured with a COD rapid measuring instrument (5B-1, Lianhua technology).

The FA and FNA concentrations were calculated according to eqn (1) and (2):²¹

$$\text{FA (mg L}^{-1}\text{)} = \frac{17}{14} \times \frac{[\text{NH}_4^+ - \text{N} + \text{NH}_3 - \text{N}] \times 10^{\text{pH}}}{10^{\text{pH}} + \exp\left(\frac{6344}{273 + T}\right)} \quad (1)$$

$$\text{FNA (mg L}^{-1}\text{)} = \frac{46}{14} \times \frac{[\text{NO}_2^- - \text{N}]}{10^{\text{pH}} \times \exp\left(\frac{-2300}{273 + T}\right)} \quad (2)$$

where [NH₄⁺-N] and [NO₂⁻-N] are the residual measured NH₄⁺-N and NO₂⁻-N concentrations, respectively and *T* is temperature.

The ammonia oxidation rate (AOR) and the specific ammonia oxidation activity (SAOA) were calculated according to eqn (3) and (4):

$$\text{AOR (mg L}^{-1} \text{ h}^{-1}\text{)} = \frac{[\text{NH}_4^+ - \text{N}]_{\text{inf}} - [\text{NH}_4^+ - \text{N}]_{\text{eff}}}{t_{\text{HRT}}} \quad (3)$$

$$\text{SAOA (mg g}^{-1} \text{ h}^{-1}\text{)} = \frac{[\text{NH}_4^+ - \text{N}]_{\text{inf}} - [\text{NH}_4^+ - \text{N}]_{\text{eff}}}{t_{\text{HRT}} \times \text{MLSS}} \quad (4)$$

where [NH₄⁺-N]_{inf} is the influent NH₄⁺-N concentration, [NH₄⁺-N]_{eff} is the effluent NH₄⁺-N concentration and *t*_{HRT} is the HRT.

The ammonia removal rate (ARR) was calculated according to eqn (5):

$$\text{ARR (\%)} = \frac{[\text{NH}_4^+ - \text{N}]_{\text{inf}} - [\text{NH}_4^+ - \text{N}]_{\text{eff}}}{[\text{NH}_4^+ - \text{N}]_{\text{inf}}} \times 100\% \quad (5)$$

The nitrate production rate (NPR) and the nitrite accumulation ratio (NAR) were calculated according to eqn (6) and (7):

$$\text{NPR (mg L}^{-1} \text{ h}^{-1}\text{)} = \frac{[\text{NO}_3^- - \text{N}]_{\text{eff}} - [\text{NO}_3^- - \text{N}]_{\text{inf}}}{t_{\text{HRT}}} \quad (6)$$

where [NO₂⁻-N]_{inf} is the influent NO₂⁻-N concentration, [NO₂⁻-N]_{eff} is the effluent NO₂⁻-N concentration, [NO₃⁻-N]_{inf} is the influent NO₃⁻-N concentration and [NO₃⁻-N]_{eff} is the effluent NO₃⁻-N concentration.

2.4. High-throughput 16S rRNA gene sequencing

Five sludge samples were collected and analyzed using high-throughput sequencing to investigate the changes in nitrifying bacteria population during the continuous-flow phase. The first sample was collected from the seed sludge whereas the second was taken after pre-aeration. The third, fourth and fifth samples were collected from the continuous-flow reactor on days 15, 27, and 38, respectively. Samples were prepared for the extraction of DNA, which was subjected to PCR amplification of 16S rRNA in V3–V4 region. The PCR products were verified by electrophoresis to generate sequencing libraries, which were sequenced and assessed by using the Illumina MiSeq sequencing platform (Illumina, San Diego, USA) to determine the bacterial community structure. The readings were classified into operational taxonomic units (OTUs) to be used for microbial diversity analysis.

2.5. Scanning electron microscope (SEM)

Filler samples were pre-treated using the method proposed in a previous study.²² Specifically, the immobilized filler was cut into 1–2 mm pieces and mixed with a 2.50% pentanediol solution for fixation in a refrigerator at 4 °C for more than 12 h. Then the immobilized filler was washed thrice with phosphate buffer saline (PBS) and dehydrated with different gradient of ethanol (50%, 70%, 80%, 90%, and 100%) for 10–15 min each time. After dehydrating, ethanol was replaced with isoamyl acetate, followed by thorough dehydration and freeze-drying for 12 h. Gold spray treatment was carried out, and observation was performed using a SU8020 scanning electron microscope.



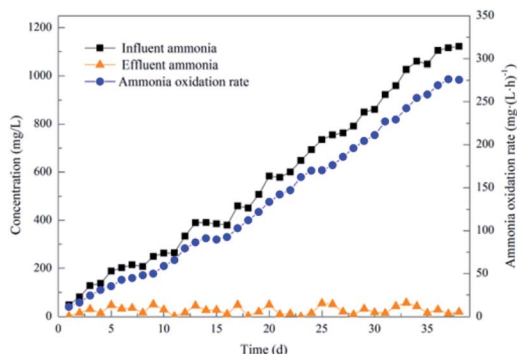


Fig. 2 Performance of the activated sludge during the operational period for the enriched nitrifying bacteria community.

3. Results and discussion

3.1. Continuous-flow reactor performance

3.1.1. Analysis of changes in ammonia and AOR. The reactor was operated in continuous mode to investigate the AOR by gradually increasing the influent ammonia from 47.40 mg L^{-1} to $1121.94 \text{ mg L}^{-1}$ (Fig. 2). With the increase of influent ammonia, the AOR began to increase rapidly, and the bacterial activity began to increase. From day 1 to day 9, the AOR was in a slow growth stage, increasing to $49.85 \text{ mg (L h)}^{-1}$; from day 10 to day 38, the AOR showed a rapid growth stage, eventually increasing to $275.58 \text{ mg (L h)}^{-1}$. During the cultivation process, nitrifying bacteria could quickly adapt to changes in the influent ammonia concentration, and it could be reduced below 20 mg L^{-1} in a short time.

3.1.2. Analysis of changes in nitrite, NPR and FNA. As evident in Fig. 3, the influent nitrite was maintained below 1.5 mg L^{-1} . During the initial stage of culture (day 1–12), the effluent nitrite was below 10 mg L^{-1} and NPR increased from $17.22 \text{ mg (L h)}^{-1}$ to $63.25 \text{ mg (L h)}^{-1}$ because NOB increased in the process according to the high-throughput sequencing analysis. From day 13, the effluent nitrite increased rapidly due to the presence of dissolved oxygen. Studies have shown that AOB have a stronger affinity and a stronger oxygen utilization capacity than NOB, resulting in the inhibition of NOB growth

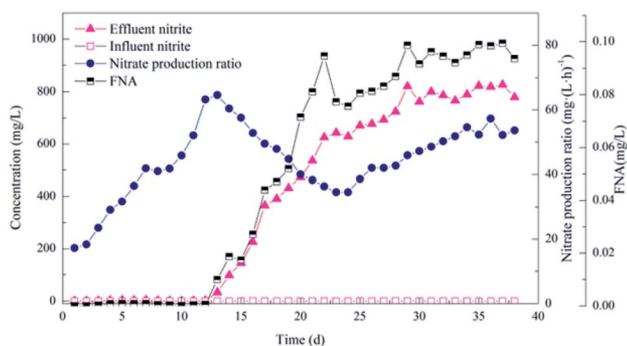


Fig. 3 Performance of the activated sludge during the operational period for the enriched nitrifying bacteria community.

and consequently an increase in effluent nitrite.²³ Further, the accumulation of nitrite could cause the FNA to gradually increase, which can also inhibit NOB to a certain extent.²⁴ This explanation is consistent with the results of high-throughput sequencing, which shows that NOB gradually decreased in the process.

Several studies reported that the NOB metabolism is inhibited when the concentration of FNA is higher than 0.02 mg L^{-1} ,²⁴ while the AOB growth is inhibited when it is higher than 0.10 mg L^{-1} . Further, the AOB activity is severely inhibited above 0.40 mg L^{-1} .²⁵ The free nitrous acid (FNA) significantly inhibited NOB and did not inhibit AOB since the FNA was above 0.02 mg L^{-1} after day 15, up to about 0.10 mg L^{-1} , resulting in gradual elimination of NOB and gradual increase of AOB. This finding is consistent with the results of high-throughput sequencing, which shows that AOB gradually became the dominant species. However, NOB adapted to regrowth after a period of inhibition,²⁶ as observed from the gradual increase of NPR after day 23.

In the enrichment culture process, the FNA in the culture process was below 0.10 mg L^{-1} after adjusting the pH. In contrast, the influent ammonia concentration was continuously increased to grow AOB grew rapidly, affecting the NOB growth due to excessive nitrite in the system. The influent ammonia was increased to maintain FA at a low level when the effluent ammonia was close to 10 mg L^{-1} . At the same time, the effect of FA on nitrifying bacteria was not considered since the inhibitory effect of FA gradually decreased as the culture progressed.²⁷

3.1.3. Analysis of changes in sludge growth and SAOA. As evident in Fig. 4, with the progress of the enrichment culture, the sludge concentration gradually decreased and then increased. SAOA increased rapidly and remained stable. MLSS decreased from 5580 mg L^{-1} (day 1) to 2758 mg L^{-1} (day 14) and then showed an increasing trend after day 15 to 7704 mg L^{-1} (day 38). SAOA increased rapidly from $2.02 \text{ mg (g h)}^{-1}$ (day 1) to $33.01 \text{ mg (g h)}^{-1}$ (day 14) before finally stabilizing at $35.77 \text{ mg (g h)}^{-1}$ on day 38. The continuous increase of SAOA confirmed that the AOB activity was constantly increasing.

The decline in MLSS at first suggests the existence of heterotrophic bacteria in the sludge enriched by pre-aeration. The oxygen consumption by nitrifying bacteria significantly increased when the influent began to provide ammonia

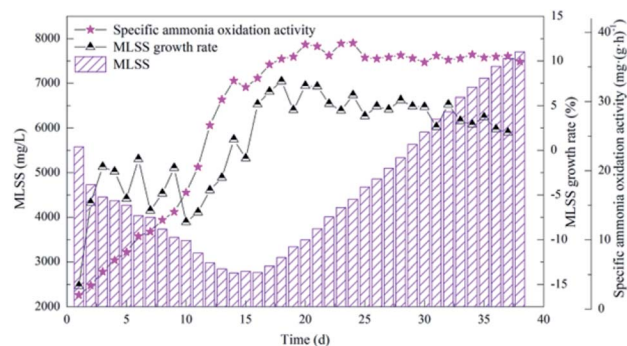


Fig. 4 Performance of the activated sludge during the operational period for the enriched nitrifying bacteria community.



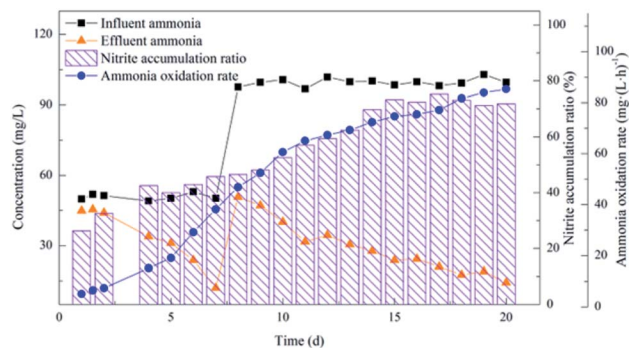


Fig. 5 Performance of immobilized fillers in the recovery.

nitrogen substrate. And the change in oxygen may cause the equilibrium state to be broken, and the remaining heterotrophic and some autotrophic bacteria that were not suitable for the environment gradually died.

3.2. Performance of immobilized fillers

3.2.1. Recovery of immobilized fillers. As evident in Fig. 5, the AOR and NAR of immobilized fillers began to increase rapidly with the progress of the experiment, indicating that the bacterial activity began to recover. From day 1 to day 5, the AOR was in a slow growth stage, increasing to 19.08 mg (L h)⁻¹, and the NAR reached to 40.02%; from day 6 to day 11, the AOR showed a rapid growth stage, increasing to 65.10 mg (L h)⁻¹, and the NAR reached to 57.05%; from day 12 to day 20, influent ammonia nitrogen was controlled at about 100 mg L⁻¹, and the AOR still slowly increased, eventually increasing to 85.30 mg (L h)⁻¹. At the same time, NAR was stable at around 70% and the effluent ammonia was 14.29 mg L⁻¹. The experiment had a short recovery period, but the nitrification rate has been greatly improved. The recovery time of this experiment was short, but the nitrification rate has been greatly increased.

The initial AOR slowly increased mainly because of the previous immobilized treatment, which had a negative impact on the activity of nitrifying bacteria. For example, saturated boric acid could inhibit bacteria. However, the efficiency rapidly increased in the later period due to the recovery of bacterial

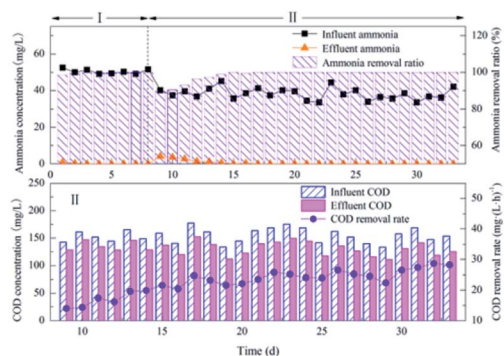


Fig. 6 Performance of immobilized fillers in the wastewater.

Table 2 Variation of sample richness and diversity^a

Sample	OUT	Shannon	Simpson	Coverage
W0	6216	6.49	5.9×10^{-3}	0.93
W1	3249	6.10	7.9×10^{-3}	0.95
W2	3559	5.02	0.04	0.96
W3	4459	3.68	0.12	0.93
W4	3053	2.45	0.35	0.96

^a W0 represented the seed sludge; W1 represented the sludge after pre-aeration; W2, W3, and W4 were cultivated sludge at days 15, 27, and 38, respectively.

activity and the continuous proliferation of nitrifying bacteria inside the filler.

3.2.2. Application of immobilized fillers. In phase I (day 1–8), the simulated ammonia nitrogen wastewater with the concentration of about 50 mg L⁻¹ was treated with fillers, which achieved the ARR of over 99% to reduce the effluent ammonia below 1 mg L⁻¹ (Fig. 6). In phase II (day 9–33), the municipal wastewater with unstable ammonia and COD was treated by the filler, and the average concentration were 38.22 mg L⁻¹ and 154.46 mg L⁻¹, respectively. At the beginning, the ARR and COD removal rate were 89.56% and 13.98 mg (L h)⁻¹, respectively. After day 10, the ARR gradually increased, effluent ammonia quickly dropped below 1 mg L⁻¹, and the AOR was up to 44.61 mg (L h)⁻¹, indicating that the immobilized filler could quickly adapt to the complex wastewater environment.

The nitrification efficiency is equivalent to the treatment of simulated wastewater, and much higher than the nitrification efficiency of the activated sludge in the wastewater treatment plant. Therefore, the immobilized filler is feasible for municipal wastewater nitrification. The main reason for COD removal could be that the influent contained a small amount of heterotrophic bacteria. Meanwhile, the network structure of suspension balls could provide some attachment space for heterotrophic bacteria, and the attachment growth of bacteria could lead to a slow increase in removal rate.

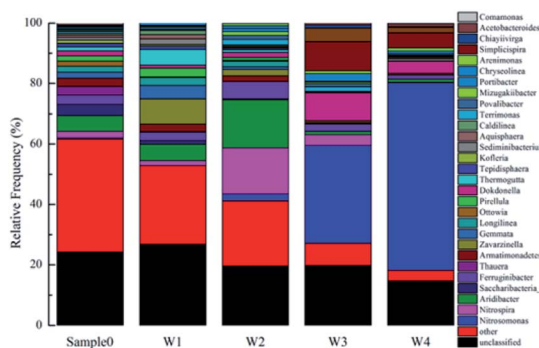


Fig. 7 Bacterial community distribution in the seed and cultivated sludge.



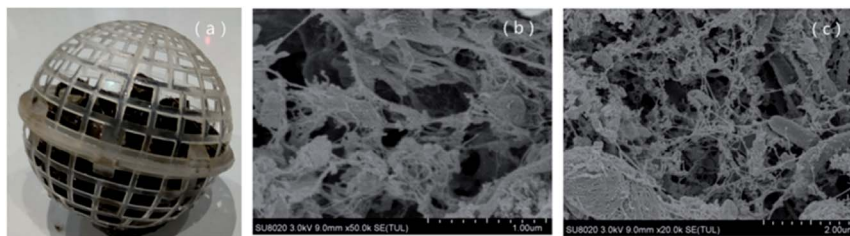


Fig. 8 Immobilized filler and different magnification of SEM images: (a) the filler during operation; (b) DM = 50 k; (c) DM = 20 k.

3.3. High-throughput sequencing for microbial diversity analysis

In high-throughput sequencing, a coverage ratio of 0.93 was achieved in five samples indicating that the result exclusively represented the microbial components of the sludge samples. Richness was reflected by the total number of OTUs. The Shannon and Simpson indices characterized the diversity of microbial components. The OTUs, Simpson and Shannon indices in the seed sludge were 6216, 5.9×10^{-3} , and 6.49, respectively (Table 2). The values of OTUs, Simpson and Shannon after pre-aeration were 3249, 7.9×10^{-3} , and 6.10, respectively. The decline of OTUs indicated that the species richness of sludge after pre-aeration was less than that of the original sludge and that there were fewer species totals.

The Shannon index followed a downward decreasing trend from 5.02, 3.68 to 2.45 during the period for nitrifying bacteria cultivation on days 15, 27, and 38, whereas the Simpson index followed an upward increasing trend from 0.04, 0.12 to 0.35. This could be because the microbial abundance and diversity declined when enriching the sludge for nitrifying bacteria, suggesting that the system performance and richness of the specifically functional population were improved with a reduction in the microbial diversity.^{28,29}

The bacterial community structure at the genus level shown in Fig. 7 illustrates the variations in microbial diversity during the operational period. Seed sludge had high microbial diversity, while the nitrifying bacteria community had a lower diversity after cultivation. The genus distribution in the original mud is relatively uniform, and it is a common strain in the wastewater treatment system.³⁰ *Aridibacter*, *Saccharibacteria_genera_incertae_sedis*, *Ferruginibacter* and *Thauera* were the predominant genera in the seed sludge with relative abundances of 5.25%, 3.75%, 2.88%, and 2.85%, respectively. They belonged to the phyla *Acidobacteria*, *Saccharibacteria*, *Bacteroidetes* and *Proteobacteria*, respectively, which are the main components of the activated sludge in the wastewater treatment system.^{31,32} The proportion of heterotrophic bacteria were greatly reduced after pre-aeration. For example, *Saccharibacteria_genera_incertae_sedis*, *Comamonas*, and *Thauera* were reduced to 1.19%, 0.1%, and 0.17%, respectively.

Nitrosomonas (*b-Proteobacteria* phylum, called AOB) and *Nitrospira* (a distinct phylum, called NOB) were present at 0.43% and 2.14%, respectively, in municipal wastewater treatment.^{33,34} These indicated that the abundance of specific functional species was very low in seed sludge. From the changes in the ratio of AOB and NOB in the first three samples, it could be seen

that AOB and NOB could quickly reproduce in the system. Due to the inhibition effect of FA, FNA and DO, NOB was gradually reducing after day 15, while the AOB that was not affected by the inhibition gradually increased to 61.91% during the period. This result is consistent with the outstanding biological nitrification performance of the high ammonia oxidation rate (approximately $275.58 \text{ mg (L h)}^{-1}$).

3.4. SEM analysis

As evident in Fig. 8, the immobilized filler had a good porosity with a large number of internal framework structures for bacterial growth and internal channels for transporting oxygen and nutrients inside. It has been shown that the ideal gel carrier should have a macroporous structure to promote unimpeded diffusion of solutes and gas release.¹⁸ In addition, the gel material should have large pores of 0.1–1 microns.³⁵ In our study, a pore size of 1–3 μm was observed (Fig. 8(b and c)). Therefore, the unique three-dimensional network structure of the PVA carrier provided a good growth microenvironment for microorganisms.

4. Conclusions

The nitrifying bacteria community was successfully enriched by continuous-flow operation with a high influent concentration to improve the ammonia oxidation rate. As a result, the ammonia oxidation rate reached approximately $275.58 \text{ mg (L h)}^{-1}$ after 38 days of enrichment. High-throughput sequencing at the genus level indicated that the diversity of the microorganisms declined during the operational period. *Nitrosomonas* (AOB) became the most dominant community after enrichment, increasing from 0.43% to 61.91%. Additionally, the study found that the filler made by high-efficiency bacteria has strong nitrification ability. And the treatment of municipal wastewater by the filler is equivalent to that of simulated wastewater, indicating that the immobilized filler is effective for municipal wastewater treatment.

Conflicts of interest

There are no conflicts to declare.

Acknowledgements

This work was supported by Beijing Municipal Commission of Education owned by the Municipal Government of Beijing



under the Program “Research on reinforcement and stability of nitrogen removal performance in wastewater treatment based on the new landmark conditions” (Z161100004516015).

Notes and references

- 1 L. Faust, H. Temmink, A. Zwiijnenburg, A. J. B. Kemperman and H. H. M. Rijnaarts, *Water Res.*, 2014, **66**, 199–207.
- 2 G. Munz, C. Lubello and J. A. Oleszkiewicz, *Chemosphere*, 2011, **83**, 720–725.
- 3 K. Yu and T. Zhang, *PLoS One*, 2012, **7**, e38183.
- 4 Y. Lin, H. Kong, Y. He, L. Kuai and Y. Inamori, *Japanese Journal of Water Treatment Biology*, 2004, **40**, 106–114.
- 5 Z. Li, Z. Zhang, J. Li and Z. Zhang, *Biodegradation*, 2009, **20**, 859–865.
- 6 W. M. Rostron, D. C. Stuckey and A. A. Young, *Water Res.*, 2001, **35**, 1169–1178.
- 7 Y. Mao and J. Wang, *Acta Sci. Circumstantiae*, 2013, **33**, 370–376.
- 8 X. Y. Xu, Z. X. Jin, B. Wang, C. P. Lv, B. B. Hu and D. Z. Shi, *Process Biochem.*, 2017, **63**, 214–220.
- 9 X. L. Qiao, Z. Liu, Z. W. Liu, Y. L. Zeng and Z. J. Zhang, *Biochem. Eng. J.*, 2010, **50**, 71–76.
- 10 M. A. Head and J. A. Oleszkiewicz, *Water Res.*, 2004, **38**, 523–530.
- 11 M. A. Head and J. A. Oleszkiewicz, *J. Environ. Eng.*, 2005, **131**, 1046–1051.
- 12 H. Shan and J. P. Obbard, *Appl. Microbiol. Biotechnol.*, 2001, **57**, 791–798.
- 13 A. Bollmann and H. J. Laanbroek, *FEMS Microbiol. Ecol.*, 2001, **37**, 211–221.
- 14 R. D. Yao, H. Yang, M. Y. Yu, Y. Liu and H. Shi, *RSC Adv.*, 2016, **6**, 113959–113966.
- 15 F. Fdz-polanco, E. Mendez, M. A. Uruena, S. Villaverde and P. A. Garcia, *Water Res.*, 2000, **34**, 4018–4089.
- 16 K. Hanaki, C. Wantawin and S. Ohgaki, *Water Res.*, 1990, **24**, 297–302.
- 17 K. Hanaki, C. Wantawin and S. Ohgaki, *Water Res.*, 1990, **24**, 289–296.
- 18 X. T. Wang, H. Yang, X. Y. Liu and Y. Su, *Sci. Total Environ.*, 2020, **710**, 135250–135258.
- 19 H. Yang and Q. K. Guan, *Water Sci. Technol.*, 2016, **74**, 1773–1779.
- 20 APHA, *Standard Methods for the examination of water and wastewater*, American Public Health Association, Washington D.C. US, 20th edn, 1998.
- 21 A. C. Anthonisen, R. C. Loehr, T. B. S. Prakasam and E. G. Srinath, *Water Pollut. Control Fed.*, 2019, **48**, 835–852.
- 22 H. Liu and H. H. P. Fang, *J. Biotechnol.*, 2002, **95**, 249–256.
- 23 S. Wyffels, P. Boeckx, K. Pynaert, W. Verstraete and O. Van Cleemput, *J. Chem. Technol. Biotechnol.*, 2003, **78**, 412–419.
- 24 V. M. Vadivelu, J. Keller and Z. Yuan, *Water Sci. Technol.*, 2007, **56**, 89–97.
- 25 V. M. Vadivelu, J. Keller and Z. Yuan, *Biotechnol. Bioeng.*, 2006, **95**, 830–839.
- 26 F. Zhang, H. Yang, J. W. Wang, Z. Q. Liu and Q. K. Guan, *RSC Adv.*, 2018, **8**, 31987–31995.
- 27 S. Villaverde, F. Fdz-Polanco and P. A. García, *Water Res.*, 2000, **34**, 602–610.
- 28 L. Shen, Y. Yao and F. Meng, *J. Membr. Sci.*, 2014, **462**, 139–146.
- 29 J. X. Ma, Z. W. Wang, Y. Yang, X. G. Mei and Z. C. Wu, *Water Res.*, 2013, **47**, 859–869.
- 30 R. Amann and B. M. Fuchs, *Nat. Rev. Microbiol.*, 2008, **6**, 339–348.
- 31 J. Snajdr, R. Amann, I. Huber, W. Ludwig and K. H. Schleifer, *Appl. Environ. Microbiol.*, 1997, **63**, 2884–2896.
- 32 X. W. Zhang, J. Zhang and Z. Hu, *RSC Adv.*, 2015, **5**, 61345–61353.
- 33 S. Siripong and B. E. Rittmann, *Water Res.*, 2007, **41**, 1110–1120.
- 34 H. Daims, J. L. Nielsen, P. H. Nielsen, K. Schleifer and M. Wagner, *Appl. Environ. Microbiol.*, 2001, **67**, 5273–5284.
- 35 V. I. Lozinsky and F. M. Plieva, *Enzyme Microb. Technol.*, 1998, **23**, 227–242.

